

GUANGZHOU APRO BUILDING MATERIAL CO., LTD

TEST REPORT

SCOPE OF WORK

WINDOWS AND DOORS

REPORT NUMBER


230616166GZC-006

ISSUE DATE

2023/8/21

PAGES

20

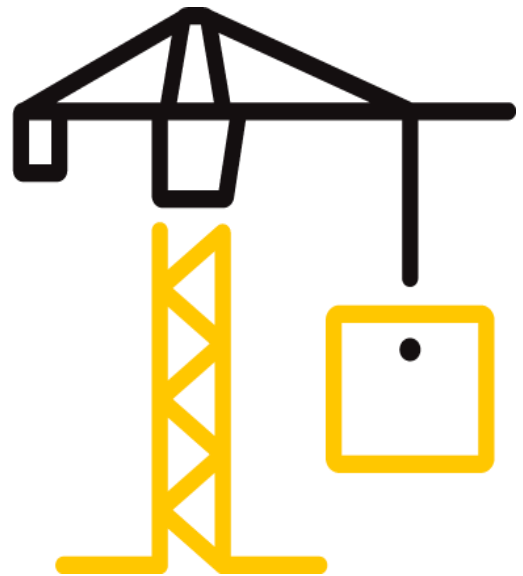

Intertek Testing Services Shenzhen Ltd. Guangzhou Branch

DOCUMENT CONTROL NUMBER

TTRF_AAMA 101_EN_a

Effective date: 2021-10-11

© 2021 Intertek

Test Report

Issue Date: 2023/8/21

Intertek Report No. : 230616166GZC-006

Applicant:	GUANGZHOU APRO BUILDING MATERIAL CO., LTD
Applicant Address:	NO.9 OF 66 HUA GANG AVENUE HUADU DISTRICT, GUANGZHOU, GUANGDONG, CHINA, 510815.
Attn:	JASON@GZAPRO.COM

Manufacturer:	GUANGZHOU APRO BUILDING MATERIAL CO., LTD
Manufacturer Address:	NO.9 OF 66 HUA GANG AVENUE HUADU DISTRICT, GUANGZHOU, GUANGDONG, CHINA, 510815.
Attn:	JASON@GZAPRO.COM

Primary designator:	Class CW-PG40: Size Tested 2400mm × 2100mm (94.49in. × 82.68in.) - Type SD
Secondary designator:	Positive Design Pressure = +1920 Pa (+40.10 psf) Negative Design Pressure = -1920 Pa (-40.10 psf) Water penetration resistance test pressure = 290 Pa (6.06 psf) Canadian Air Infiltration/Exfiltration = A3 level

SUBJECT: Performance testing
< Sliding Door >

Dear Sir,

This test report for represents the results of our evaluation of the above referenced product(s) to the requirements contained in the following standards:

TEST METHODS AND STANDARDS
AAMA/WDMA/CSA 101/I.S.2/A440-17 (NAFS 2017 - North American Fenestration Standard / Specification for Windows, Doors and Skylights) CSA A440S1-19 (Canadian Supplement to AAMA/WDMA/CSA 101/I.S.2/A440-17)

SAMPLE ID	MODEL	SPECIFICATION
S230616166GZU.002	A140T series	2400 mm (Width) × 2100 mm (Height) × 140 mm (Thickness)

SAMPLE RECEIVED: 2023/8/2
TESTED FROM: 2023/8/11 TO 2023/8/11

TEST LOCATION: C2-1 Building Heping Fair, Yongning Street, Zengcheng District, Guangzhou, China

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program. All the tests results give the statement of conformity refer to the decision rule of "Procedure 2 "Accuracy Method" as stated in the IEC Guide 115:2007.



Test Report

Issue Date: 2023/8/21

Intertek Report No. : 230616166GZC-006

Test Items, Method and Results:

1 Test Samples

Sample was submitted to Intertek directly from the client. Sample was not independently selected for testing. Sample was received at the Evaluation Center on August 2, 2023.

A full scale sample of A140T series Lift & Sliding Door (Model: A140T series) was provided by the manufacturer that was not weathered nor conditioned.

The description of the samples given below has been prepared from information provided by the sponsor of the test. All values quoted are nominal, unless tolerances are given.

Table 1 Product Information

Product Name	A140T series Lift & Sliding Door
Model	A140T series
Dimension of Door Frame	2400 mm (Width) × 2100 mm (Height) × 140 mm (Thickness)
Dimension of Door Leaf	Operable Sash: 1208.8 mm (Width) × 2039 mm (Height) × 55 mm (Thickness) Fixed Sash: 1208.8 mm (Width) × 2039 mm (Height) × 55 mm (Thickness)
Aluminum Profile	Model: MD-T14004/MD-T14005/MD-T14003/MD-T14001/MD-14005C /MD-T14001E/MD-14001D/MD-T14005D/WTS12050 Supplier: Foshan Fei Bo Metal Co., Ltd
Frame Corner Construction Details	Mitre-cut, assembly with corners keys
Reinforcement	Not applicable
Glazing	Dimension: 1053 mm (Width) × 1883 mm (Height); Quantity: 2 Structure: 42mm (6mm Low-e+12(argon)+6mmLow-e+12(argon)+6mm Clear) tempered Triple Tempered glass Supplier: JIANGMEN JUNFA SAFETY GLASS CO., LTD
Weather-strip	Model: 5*7mm Supplier: Haida
Thermal Break	Model: TB24//TB14.8 Supplier: Foshan LAMPSTONE Plastic Co., Ltd
Drainage	Sizes: 35 mm (Width) × 5 mm (Height) Quantity: 5
Gasket	Model: MDF12018/MDF12024/MDF12021/MDF12011/EP190D/2083/EP775H Material: EPDM Supplier: Foshan Gui Mi Rubber & Plastic Co., Ltd



Test Report

Issue Date: 2023/8/21

Intertek Report No. : 230616166GZC-006

Table 1 Product Information(Cont.)

Hardware	<ol style="list-style-type: none"> 1. Spindle Drive Handle with Koln; Model: F800019 2. Espagnolette with Tilt Lock Point-2300mm; Model: F020009 3. Front & Rear Roller; Model: F800016 4. Connecting Rod-850mm; Model: F020004 5. Space pack-17mm; Model: F140003 6. Screw Pack; Model: F110011 7. 23 Keeper; Model: F100008 8. Panel Stop; Model: F080001 9. Rest Block; Model: F110008 10. Top Anti-Swing Wheel; Model: MD-FB0004LX-64 11. Top Anti-Swing Wheel; Model: MD-FB0004RX-4 <p>Supplier: CMECH</p>
Sealant of Glass	<p>Model: SS550</p> <p>Material: Silicone sealant</p> <p>Supplier: Guangzhou Baiyun Chemical Industry Co., Ltd</p>
Installation	<p>The rough opening allowed for a 1/4" shim space. The exterior perimeter of the test specimen was sealed with silicone sealant.</p>

The sample ID number was S230616166GZU.002. The drawings of the representative sample were referenced in Appendix A, the test data was referenced in Appendix B and the photo of the representative sample was referenced in Appendix C.

Test Report

Issue Date: 2023/8/21

Intertek Report No. : 230616166GZC-006

Test Items, Method and Results:

2 Test Result

Table 2 Test Result

Test Description	Requirements (Class CW-PG40)		Results		Verdict
Operating Force Test	Maximum force to initiate motion	180 N	Maximum force to initiate motion	147 N	Pass
	Maximum force to maintain motion	115 N	Maximum force to maintain motion	82 N	
Air leakage resistance test	Maximum air leakage at +75 Pa	0.5 L/s·m ²	Air leakage at +75 Pa	0.19 L/s·m ²	Pass
	Maximum air leakage at -75 Pa	0.5 L/s·m ²	Air leakage at -75 Pa	0.24 L/s·m ²	
Water penetration resistance test	Minimum water pressure	290 Pa	Test Pressure	290 Pa	Pass
			No water penetration occurred at 290Pa by the method of cyclic static air pressure difference during and after test.		
Uniform load deflection test at design pressure	Design Pressure (DP)	1920 Pa	Test Pressure	1920 Pa	Pass
			Maximum deflection at handle side stile	1.9 mm	
			Maximum deflection at interlocking stile	7.3 mm	

Test Report

Issue Date: 2023/8/21

Intertek Report No. : 230616166GZC-006

Table 2 Test Result(Cont.)

Test Description	Requirements (Class CW-PG40)		Results		Verdict
Uniform load structural test	Structural Test Pressure (STP)	2880 Pa	Test Pressure	2880 Pa	Pass
			After the test loads were released, there was no failure or permanent deformation of any part of the door system that would cause the test specimen to be inoperable. There was no permanent deformation which was in excess of 0.3% of its span.		
			Maximum deflection at handle side stile	0.3 mm	
			Maximum deflection at interlocking stile	2.1 mm	
Deglazing test	<p>Load for vertical sash member: 320 N</p> <p>Panel members shall not move from their original position by more than 90% of the original glazing bite. The test specimen shall not be damaged in any way that would inhibit normal operation of the window or door. And there shall be no glazing breakage.</p>		<p>Movement of vertical sash member: 8.7%</p> <p>Operation of test specimen was normal after testing. And there was no glazing breakage.</p>		Pass
Forced-entry Resistance Test	Minimum Grade 10		Test Class	Grade 10	Pass
			After test, there was no opening which allows for entrance through the tested specimen. The sash remained locked and closed. Lock was not disengaged.		

EN2
标准
测
4

Test Report

Issue Date: 2023/8/21

Intertek Report No. : 230616166GZC-006

Appendix A: Sample Drawings

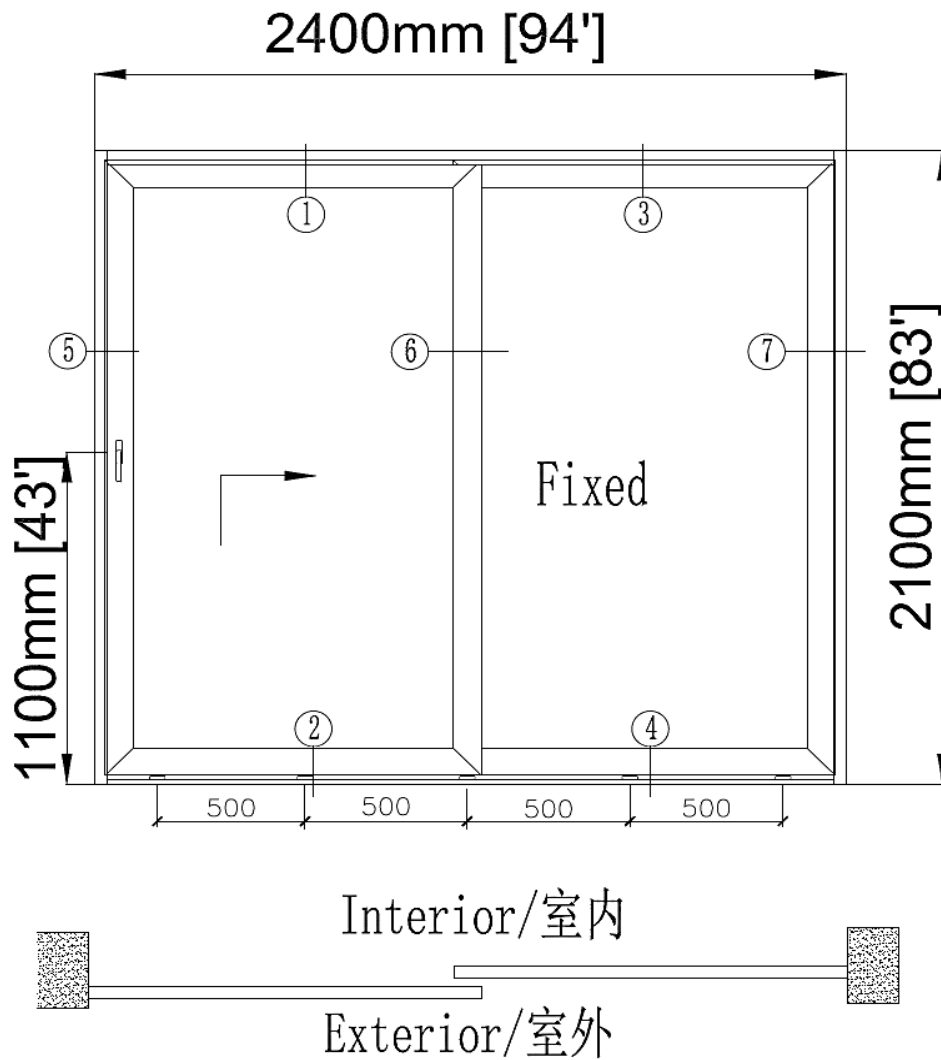


Fig.1 Drawing of Representative Sample

Test Report

Issue Date: 2023/8/21

Intertek Report No. : 230616166GZC-006

Appendix B: Test Data

B.1 Operating Force Test

Table B.1 Test Data of Operating Force Test

Force Type		Force Data, N				Requirement	Verdict
		1#	2#	3#	Average		
Initiate motion	Open	148	149	144	147	No more than 180N	Pass
	Close	86	89	84	86		
Maintain motion	Open	79	82	86	82	No more than 110N	Pass
	Close	67	72	73	71		

The tested specimen met the requirements of Operating Force Test as per AAMA/WDMA/CSA 101/I.S.2/A440-17 and CSA A440S1-19.

Test Report

Issue Date: 2023/8/21

Intertek Report No. : 230616166GZC-006

Appendix B: Test Data

B.2 Air Leakage Resistance Test – Test method: ASTM E283/E283M-2019

Door area: 5.04 m² (54.25 ft²)

Table B.2 Test Data of Air Leakage Resistance Test

	Air Leakage in cfm/ft ²	Air Leakage in L/s·m ²
Infiltration rate (75 Pa)	0.037	0.19
Exfiltration rate (75 Pa)	0.048	0.24
Average air leakage rate (75 Pa)	0.043	0.22

The tested specimen met the requirements of Class CW-PG40 for Air Leakage Resistance Test as per AAMA/WDMA/CSA 101/I.S.2/A440-17 and CSA A440S1-19.



Test Report

Issue Date: 2023/8/21

Intertek Report No. : 230616166GZC-006

Appendix B: Test Data

B.3 Water resistance test – Test method ASTM E547-2000(R2016)

No water penetration occurred at 290Pa by the method of cyclic static air pressure difference during and after test according to ASTM E547-2000(R2016).

The tested specimen met the requirements of Class CW-PG40 for Water Penetration Resistance Test as per AAMA/WDMA/CSA 101/I.S.2/A440-17 and CSA A440S1-19.

Test Report

Issue Date: 2023/8/21

Intertek Report No. : 230616166GZC-006

Appendix B: Test Data

B.4 Uniform Load Deflection Test – Test method ASTM E330/E330M-2014, Procedure A

Span length, L1 = 1940 mm (Point: #1-3 for Handle side stile)
Span length, L2 = 1940 mm (Point: #4-6 for Interlocking stile)

Test Pressure (DP), P = 1920 Pa

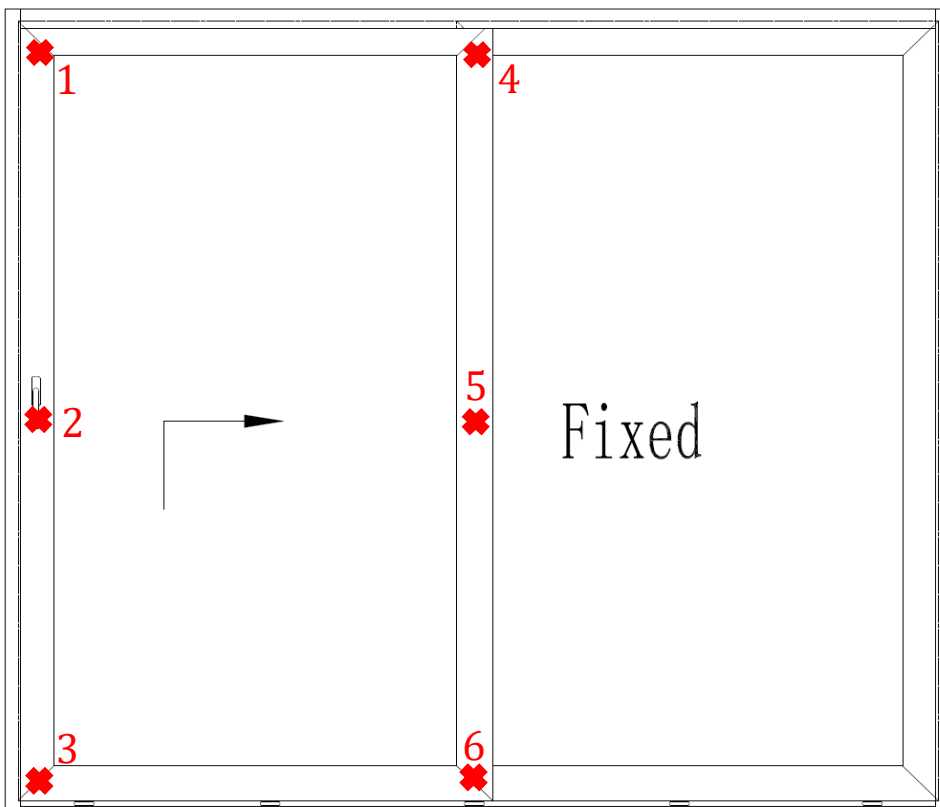


Fig.8 Locations of Displacement Measuring Devices

Test Report

Issue Date: 2023/8/21

Intertek Report No. : 230616166GZC-006

B.4 Uniform Load Deflection Test – Test method ASTM E330/E330M-2014, Procedure A (Cont.)

Table B.3 Test Data of Uniform Load Deflection Test

Member (mm)		Test Pressure (Pa)	Displacement (mm)			Deflection
Item	Span Length		1	2	3	
Handle side stile	1940	+P = +1920	0.5	2.4	0.7	1.8
		0	0.1	0.3	0.1	0.2
		-P = -1920	1.2	2.9	0.9	1.9
		0	0.1	0.3	0.1	0.2
Member (mm)		Test Pressure (Pa)	Displacement (mm)			Deflection
Item	Span Length		4	5	6	
Interlocking stile	1940	+P = +1920	3.8	9.1	2.1	6.2
		0	0.1	0.3	0.1	0.2
		-P = -1920	2.9	10.5	3.5	7.3
		0	0.1	0.9	0.2	0.8

Table B.4 Test Data of Uniform Load Deflection Test for Handle Side Stile

Test Pressure	Positive		Negative	
	Deflection	Perm. Set	Deflection	Perm. Set
Measurements, mm	1.8	0.2	1.9	0.2
Deflection limit at design pressure, L1/175=11.09 mm				

Table B.5 Test Data of Uniform Load Deflection Test for Interlocking Stile

Test Pressure	Positive		Negative	
	Deflection	Perm. Set	Deflection	Perm. Set
Measurements, mm	6.2	0.2	7.3	0.8
Deflection limit at design pressure, L2/175=11.09 mm				

During each load, no main frame or sash member deflected more than L/175, where L is the length of the unsupported span. And no damage was found, the operation was normal after testing. The tested specimen met the requirements for Class CW-PG40 for Uniform Load Deflection Test as per AAMA/WDMA/CSA 101/I.S.2/A440-17 and CSA A440S1-19.

Test Report

Issue Date: 2023/8/21

Intertek Report No. : 230616166GZC-006

Appendix B: Test Data

B.5 Uniform Load Structural Test – Test method ASTM E330/E330M-2014, Procedure A

Design Pressure, P = 1920 Pa ; Structural Pressure, P = 2880 Pa

Table B.6 Test Data of Uniform Load Structural Test

Member (mm)		Test Pressure (Pa)	Permanent deformation(mm)			Net permanent deformation,mm
Item	Span Length		1	2	3	
Handle side stile	1940	+P = +2880	—	—	—	—
		0	0.1	0.4	0.2	0.3
		-P = -2880	—	—	—	—
		0	0.1	0.4	0.1	0.3
Member (mm)		Test Pressure (Pa)	Permanent deformation(mm)			Net permanent deformation,mm
Item	Span Length		4	5	6	
Interlocking stile	1940	+P = +2880	—	—	—	—
		0	0.1	1.4	0.2	1.3
		-P = -2880	—	—	—	—
		0	0.3	2.4	0.3	2.1

Table B.7 Test Data of Uniform Load Structural Test for Handle Side Stile

Test Pressure	Perm. Set	
	Positive	Negative
Measurements, mm	0.3	0.3
Permanent deflection limit, L1*0.3%=5.82 mm		

Table B.8 Test Data of Uniform Load Structural Test for Interlocking Stile

Test Pressure	Perm. Set	
	Positive	Negative
Measurements, mm	1.3	2.1
Permanent deflection limit, L2*0.3%=5.82 mm		

After the test loads were released, there was no failure or permanent deformation of any part of the door system that would cause the test specimen to be inoperable. There was no permanent deformation which was in excess of 0.3% of its span.

The tested specimen met the requirements of Class CW-PG40 for Uniform Load Structural Test as per AAMA/WDMA/CSA 101/I.S.2/A440-17 and CSA A440S1-19.

Test Report

Issue Date: 2023/8/21

Intertek Report No. : 230616166GZC-006

Appendix C: Sample Received Photo



REPORT AUTHORIZED

When signed with physical or electronic signature, the contents of this report have been prepared and approved per Intertek's quality process in accordance with ISO 17025.

Approved by:

Prepared by:

Ziqing Chen

Oliver Zhu

Name: Ziqing Chen

Name: Oliver Zhu

Title: Reviewer

Title: Project Engineer

Revision:

Revision No.	Date	Revision Reason	Revision Summary	Author	Reviewer
R0	/	/	Original Report Issue	/	/

End of Test Report